



MAR 10 1937 1
of san. 1644

| CORRECTION RECORD | | | |
|-------------------|------------------------|-------------|---------------|
| REV'D | DATE OF NO. CORRECTION | ATTACHED BY | DATE ATTACHED |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |

KEY

(S) SHEDS
 (O) OIL TANKS
 (B) BUILDINGS
 (C) CHIMNEYS
 (D) DRAINAGE
 (E) ELEVATIONS
 (F) FENCES
 (G) GULLIES
 (H) HIGHWAYS
 (I) IRONWORK
 (J) JUNCTIONS
 (K) KILNS
 (L) LUMBER
 (M) MACHINERY
 (N) NAIL YARDS
 (P) PAVEMENT
 (Q) QUARRIES
 (R) RAILS
 (S) SHEDS
 (T) TANKS
 (U) UTILITY
 (V) VENTILATORS
 (W) WAREHOUSES
 (X) X-RAYS
 (Y) YARDS
 (Z) ZONES

APR 15 1937
Library of Congress

PAVING—School St. is concrete paved; others are macadamized or generally improved.
GRADES—Light, sloping lower toward the East.




WATER FACILITIES

Municipal ownership. Source from springs, located 2 miles southwest of Town Hall. Direct pumping and gravity pressure system. 1 water tank, capacity 100,000 gallons, located just off N. Main St. on 100' steel trestle. 1 Gould electric pump, capacity 400 gallons per minute. 1 Gould gasoline pump, capacity 400 gallons per minute, in reserve.
About 2 1/2 miles of 4" and 6" cast-iron mains. 33 double hydrants. Average pressure 65 lbs.

FIRE DEPARTMENT

Volunteer. 1 chief, 2 assistant chiefs and 29 men.
1 Ford triple combination truck with 200 gallon per minute pump, one 100 gallon booster tank and 1,600' hose. 1 Ford hook and ladder truck with one 50 gallon chemical tank.
Fire alarm by electric siren on Fire Station with switch in glass front box.

No Fire Limits. No Fire-resistant Roofing Ordinances.

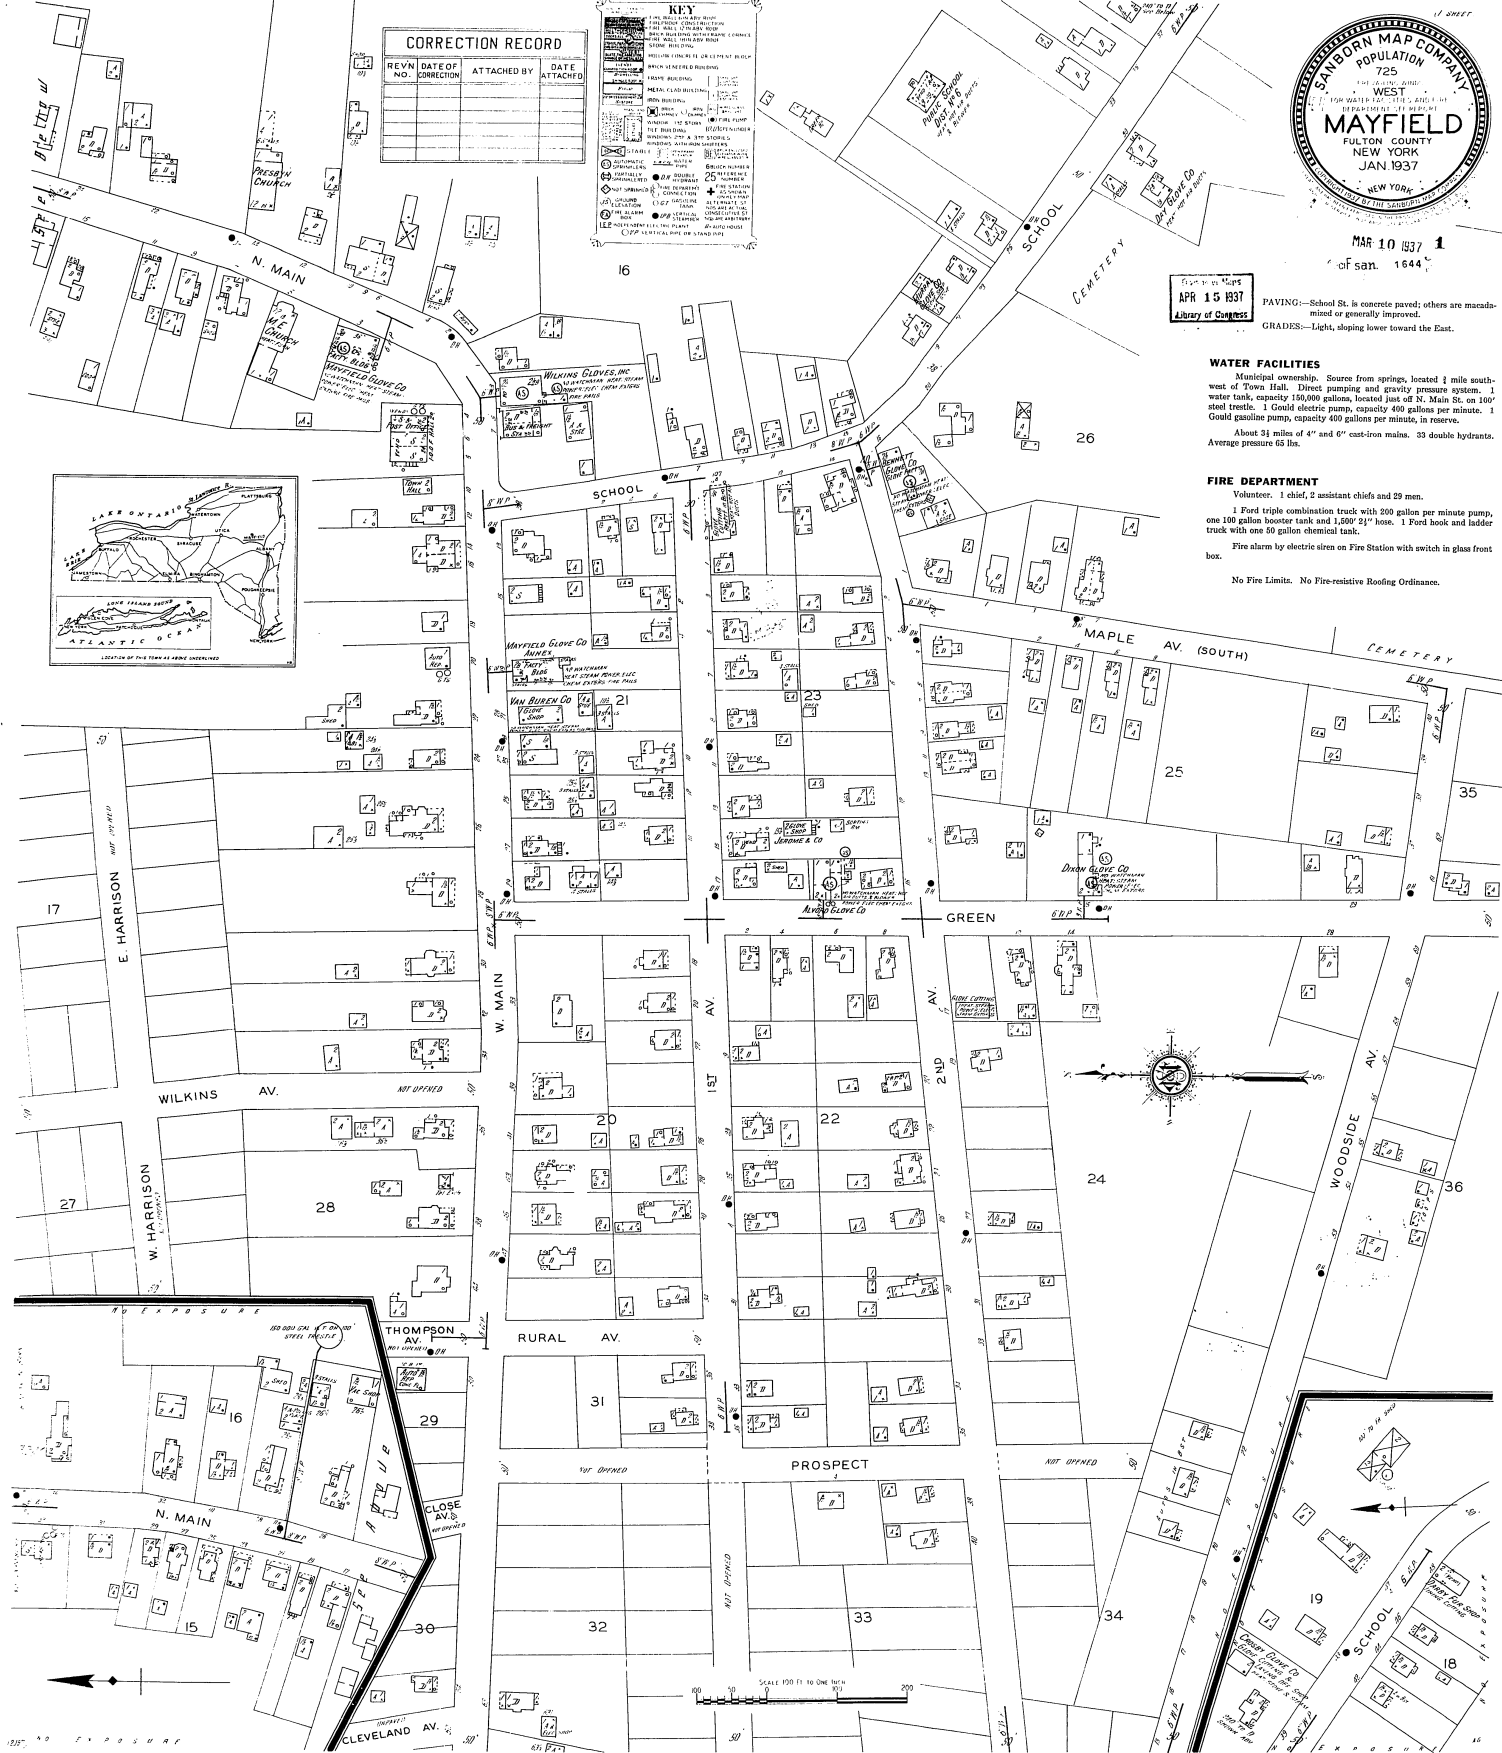

SCALE 100 FT TO ONE INCH

1937